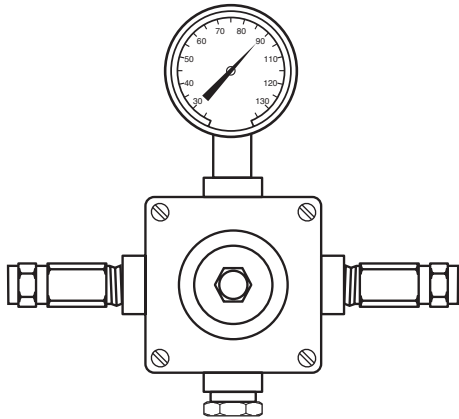


SE-370

Emergency Eye Wash Valve

**CAPACITIES - SE 370**

Pressure Drop PSI	5	10	20	30	45
Tempered Flow	2	3	5	7	10
Cold Water Bypass	1	2	4	5	7

Operating Principle

This SE-370 Emergency Eye Wash/Face Wash mixing valve is made of a thermostat element with a stainless steel sliding piston and liner housed in a bronze casting. The thermostatic cartridge responds to temperature changes in the hot and cold water supplies. In the event the thermostatic element fails or the hot water supply fails, the valve will provide full cold water bypass flow.

Note: Valve must be installed with check valves. If shut off valves are installed in the shower line for maintenance purposes, provisions shall be made to prevent unauthorized shut off.

Caution: When maintaining and adjusting the mixing valve the delivered flushing fluid temperature shall be 60°F (15°C) to 95°F (35°C). In circumstances where chemical reaction is accelerated by flushing fluid temperature, a medical advisor should be consulted for the optimum temperature for each application.

Setting the Mixing Valve


Caution: When maintaining and adjusting the mixing valve, all fixtures should be isolated from use. Speakman recommends that you work safely at all times and in a manner consistent with the OSHA Lock/Tagout standard, 29 CFR 1910.147 and other applicable standards.

This mixing valve has been set at the factory to deliver 85°F outlet flow. Should the valve require adjustment, or an application require a different set temperature, proceed as follows:

1. Contact the proper medical and safety authorities to determine the correct water temperature for the specific application (i.e.; chemicals).
2. Remove the rounded cover nut on front of the valve body.
3. Create a draw on the mixing valve by opening a downstream eye wash fixture.
4. Insert a $\frac{5}{32}$ " allen key into the stem opening of the valve and seat in the adjustment screw (not shown). Set the outlet temperature by turning the adjustment screw clockwise to reduce temperature, counterclockwise to increase temperature. Use the dial thermometer to measure the outlet temperature.
5. Replace rounded cover nut.

DIMENSIONS: 1/2" inlets & outlets

Valve Number	A	B	C
SE 370	9"	4"	8"

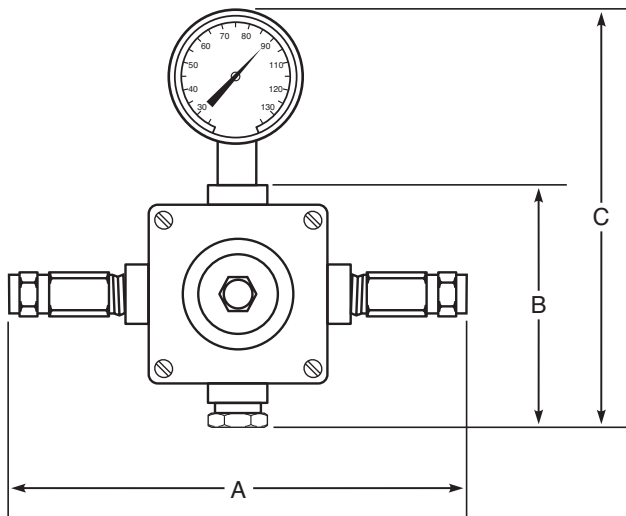

Testing the Mixing Valve

The mixing valve and the emergency fixtures it serves should be tested weekly for proper operation.

Valve temperature test procedure is as follows:

1. Activate eye wash fixture to observe and record the temperature of the dial thermometer. If the temperature of the thermometer is not correct, readjust the mixing valve according to the section "Setting the Mixing Valve".
2. Observe the flow from the emergency fixtures to ensure an adequate flow of water.

In addition to testing for proper temperature, the cold water bypass and hot water shut down features of the mixing valve should be tested weekly.

The test procedure is as follows:

1. Test valve temperature as described in Step 1 and Step 2 above.
2. Shut off the hot water supply to the mixing valve. Observe the outlet flow from the emergency fixtures to ensure an adequate flow of cold water. A slight drop in flow may occur after shutting down the hot water supply to the mixing valve, however, the drop should be minimal and for a short duration.
3. Open the hot water supply to the mixing valve. The thermometer should return to the set temperature.
4. Shut off the cold water supply to the mixing valve. The flow of water should shut down rapidly.


5. Open the cold water supply. The thermometer should return to the set temperature.

Note: The thermometer should be checked at least every six months.


Replacing the Thermostat Element

The thermostat replacement procedure is as follows:

1. Shut off the hot water supply and cold water supply to the mixing valve.
2. Remove the four cover screws (#9) and remove the front cover (#26) of the valve.
3. Remove thermostat (#11) from the valve body. No special tools are necessary.
4. Insert a dowel rod, pencil (eraser-end), or narrow pen into the open end of the thermostat. Push on the dowel rod with your hand. If the thermostat feels spongy or springy, the thermostat has lost its charge. If the thermostat feels solid or hard, the thermostat is good and operable.
5. Be sure that the stainless steel piston (#15) moves freely up and down within the liner (#21). Lime or calcium buildup should be cleaned with vinegar, green scotch pad, or fine emery cloth.

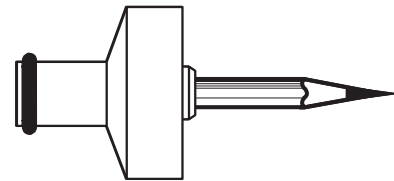

CAPACITY OF THE SE-370 THERMOSTATIC MIXING VALVE FOR EMERGENCY SHOWERS

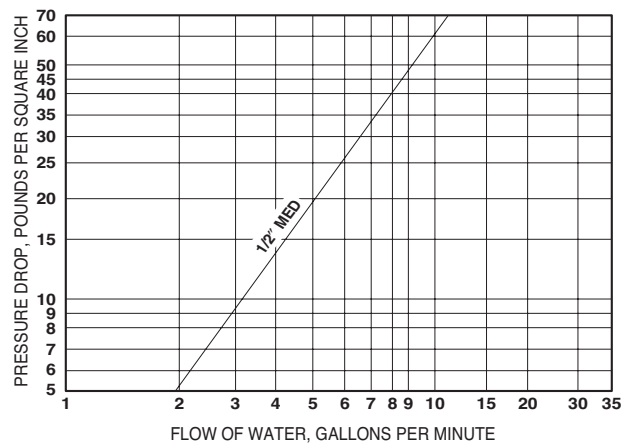

Note: Gallon per minute capacities may vary depending upon incoming water temperatures and pressures. Hot and cold water inlet pressures must be equal.

Installation

After installing the mixing valve, be sure to flush the system of debris. Speakman recommends isolation and check valves for proper maintenance.

Typical Installation *Figure 1*

When installed without a recirculation system:

Install the valve as shown in *Figure 1* with the mixing valve positioned below the hot water tank or heater. If this is not possible, pipe in heat trap as shown.

Typical Installation *Figure 2*

When installed with a recirculating pump on the hot water supply line only:

Note: If the valve is installed 20 feet or more from the water heater, it is important to recirculate the hot water supply to the mixing valve.

Install the mixing valve as shown in *Figure 2*. The non-circulated loop should be limited to 10 feet and must be flushed periodically.


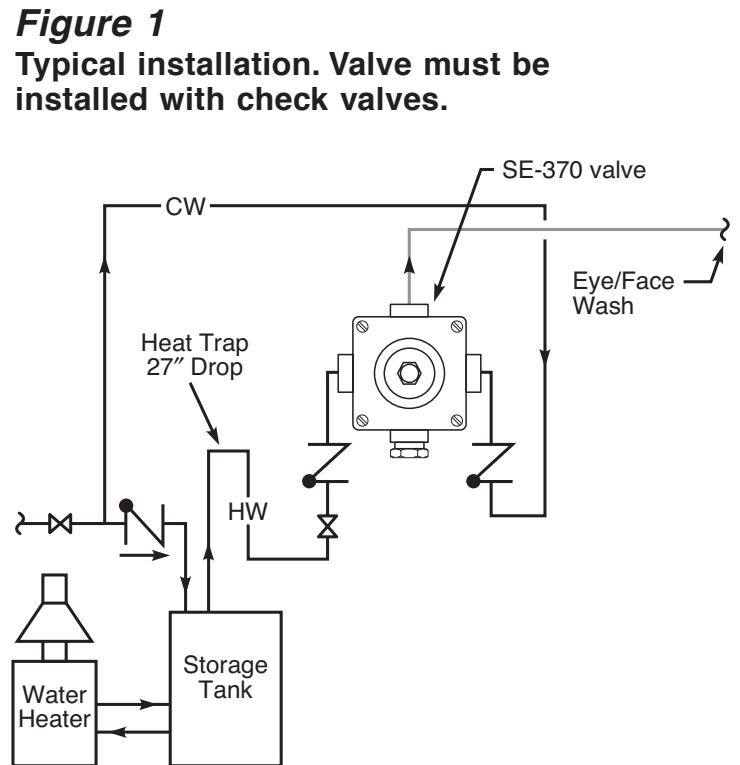


Figure 2
Typical installation. Valve must be installed with check valves.

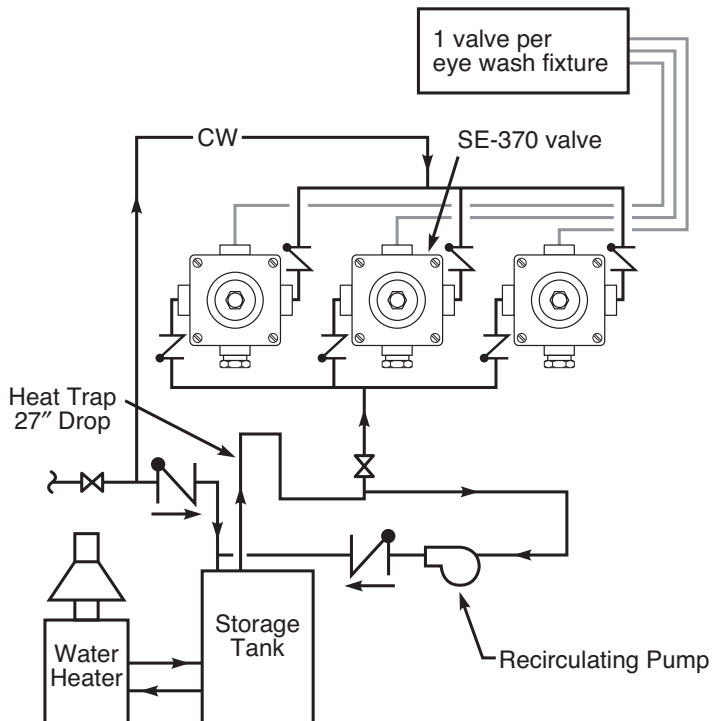

Caution: The cold water line must be installed so that it is not affected by excessively hot ambient temperatures. An example of hot ambient temperature is a long run of pipe exposed to direct sunlight. Cold water pipe installed in the ceilings of boiler rooms or rooms that increase ambient temperature require a recirculating pump.

Note: The mixing valve must be installed with inlet check valves and the Eyewash/Facewash fixture should be installed 4 to 10 feet from the mixing valve.

Note: The valve body must be maintained at an ambient room temperature of above 50°F to prevent premature closure of the safety back-seat mechanism.

GUARANTEE

We guarantee the Speakman Mixing Valve to be free from defects in workmanship and material, and, for a period of one year from date of purchase, will replace any parts found by Speakman to be defective. Speakman will not be held


responsible, however, for any labor incidental to, or for any damages caused by, defective material. Each mixing valve is thoroughly inspected and tested under actual conditions at our factory.

SE-370 Test Record

Location _____

	Date	T1	
	Jan		
	Feb		
	March		
YEAR	April		
	May		
	June		
	July		
	Aug		
	Sept		
	Oct		
	Nov		
	Dec		
		Jan	
		Feb	
		March	
YEAR	April		
	May		
	June		
	July		
	Aug		
	Sept		
	Oct		
	Nov		
	Dec		
		Jan	
		Feb	
		March	
YEAR	April		
	May		
	June		
	July		
	Aug		
	Sept		
	Oct		
	Nov		
	Dec		

Parts Break Down

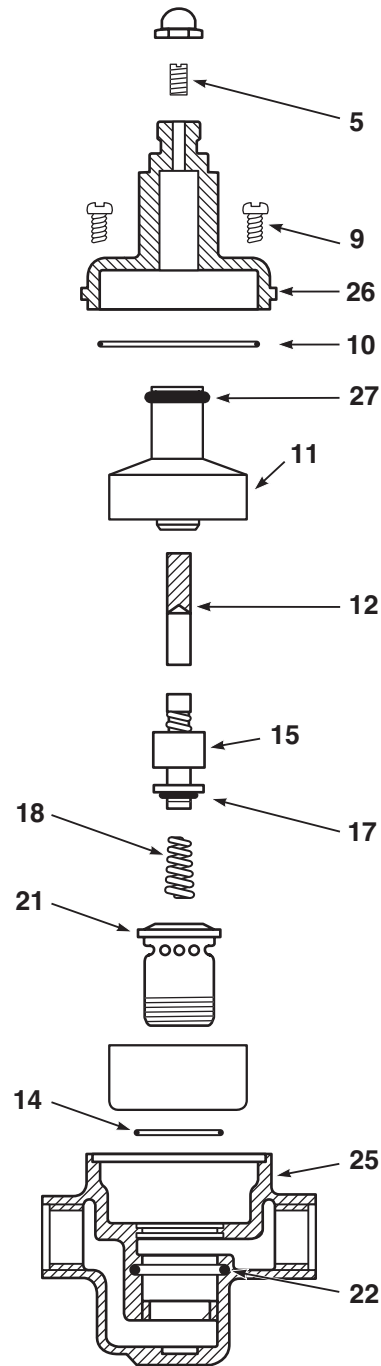

Repair Kits and Assemblies

Item	Description	Contains	Part No.
A	Repair Kit	11-12-15-18-21+B	79854-00
B	O-Ring & Gasket Kit	10-14-17-22-27	79961-00
C	Cover Assy.	4-5-10-26	78271-00
D	Piston & Liner Assembly	14-15-21-18-17	72904-60
E	Thermostat Assy.	10-11-27	78490-00