



T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088
Travelers Rest, SC 29690



REG. #A2601
ISO #9001

Model No.
016647-45

Item No.

Travelers Rest, SC: 800-476-4103 Simi Valley, CA: 800-423-0150 Fax: 864-834-3518 www.tsbrass.com

This Space for Architect/Engineer Approval



Job Name _____ Date _____

Model Specified _____ Quantity _____

Customer/Wholesaler _____

Contractor _____

Architect/Engineer _____

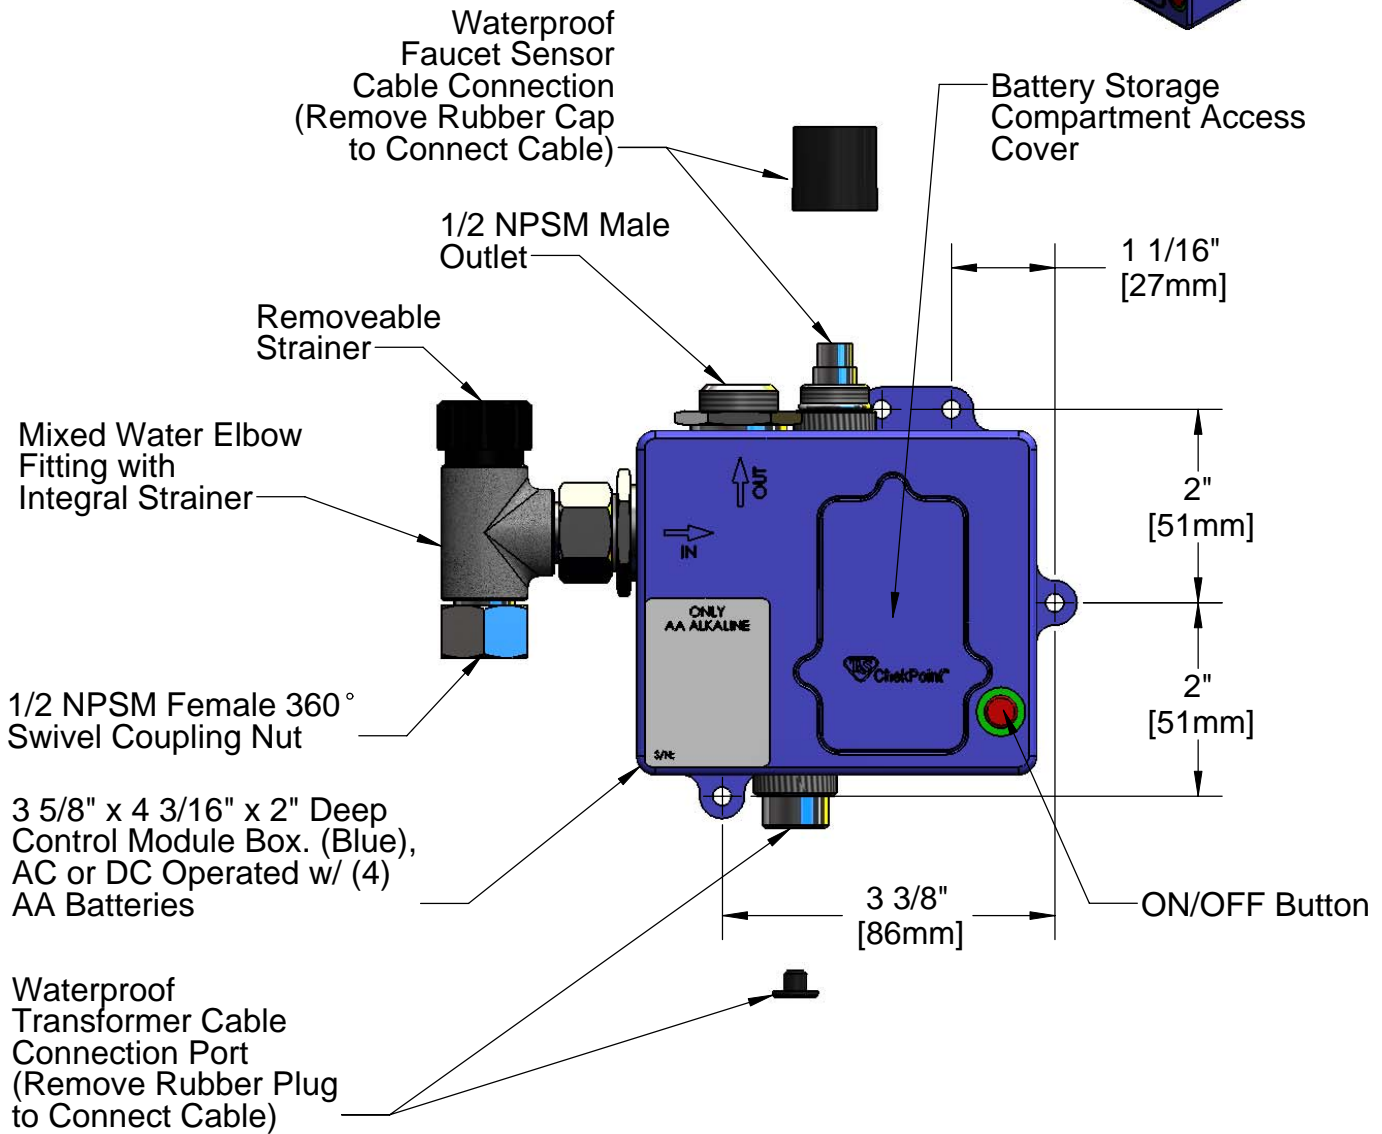

Product Specifications:

ChekPoint Sensor Faucet Control Module with Internal Flow Control Setting Switches (Blue Module Housing)

Drawn GEF	Checked JRM	Approved JHB
Scale: NTS		Date: 05/22/08



T&S BRASS AND BRONZE WORKS, INC.
 2 Saddleback Cove / P.O. Box 1088
 Travelers Rest, SC 29690




REG. #A2601
 ISO #9001

Model No.
016647-45

Item No.

Travelers Rest, SC: 800-476-4103 Simi Valley, CA: 800-423-0150 Fax: 864-834-3518 www.tsbrass.com

Label for Flow Control Switch Settings
 is Located on Inside of Back Cover.

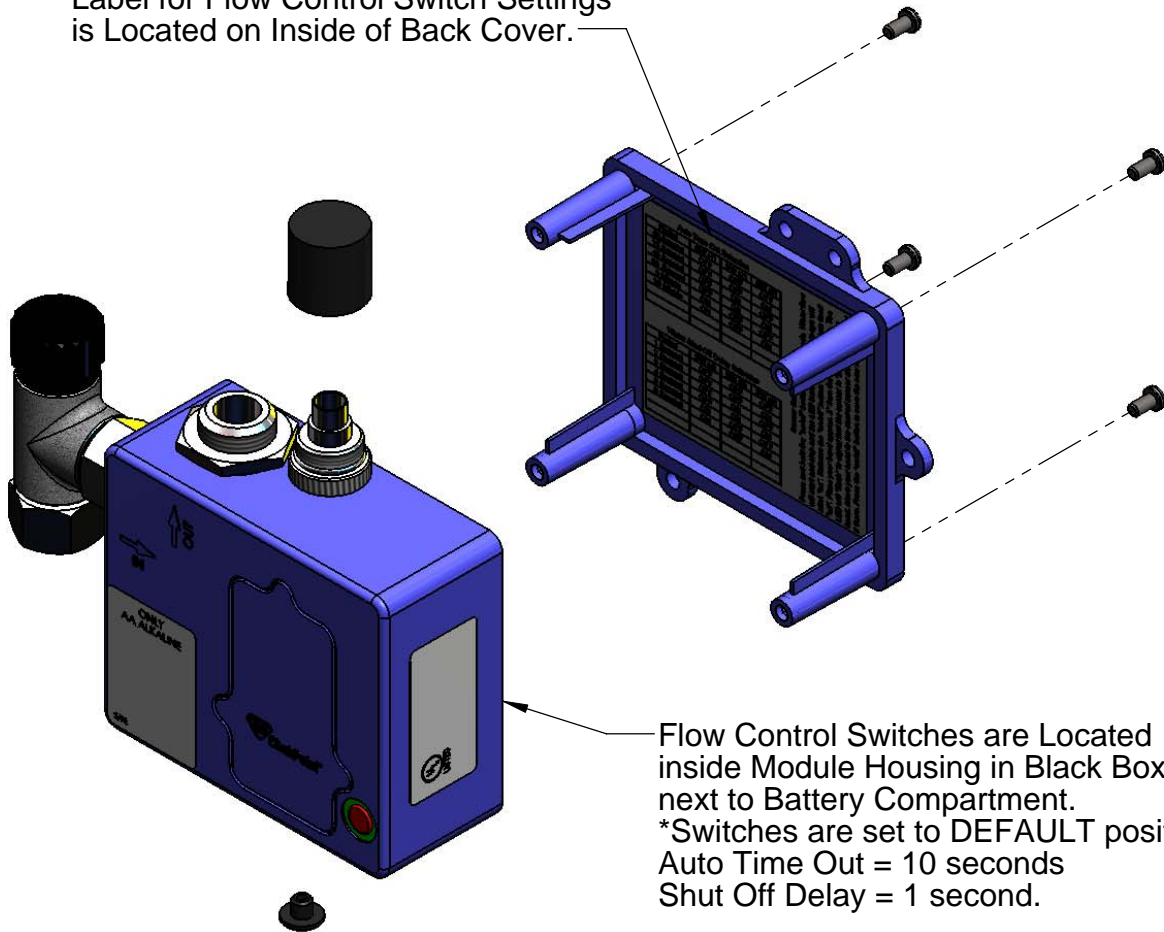

Flow Control Switches are Located
 inside Module Housing in Black Box
 next to Battery Compartment.
 *Switches are set to DEFAULT position:
 Auto Time Out = 10 seconds
 Shut Off Delay = 1 second.

Remove (4) screws and back cover to
 access switches.

*Available Water Flow Control Selections:

- (6) Auto Time Out Selections - 10 sec, 25 sec, 45 sec, 60 sec, 3 min, 20 min
- (6) Shut Off Delay Selections - 1 sec, 2 sec, 3 sec, 4 sec, 5 sec, 6 sec

Product Specifications:

**ChekPoint Sensor Faucet Control Module
 with Internal Flow Control Setting Switches
 (Blue Module Housing)**

Drawn GEF	Checked JRM	Approved JHB
Scale: NTS		Date: 05/22/08